
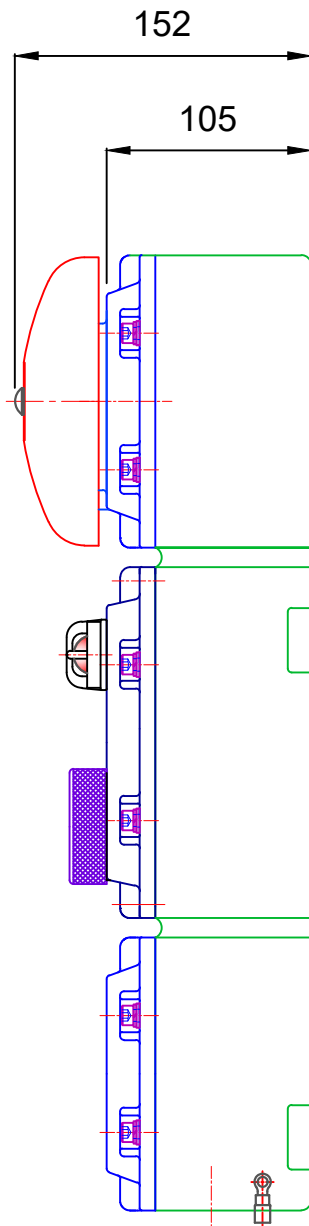


DWG NO.

1.EX TYPE ALARM MANUAL STATION (P Type 2 Class) $\nabla / (\nabla / , \nabla /)$

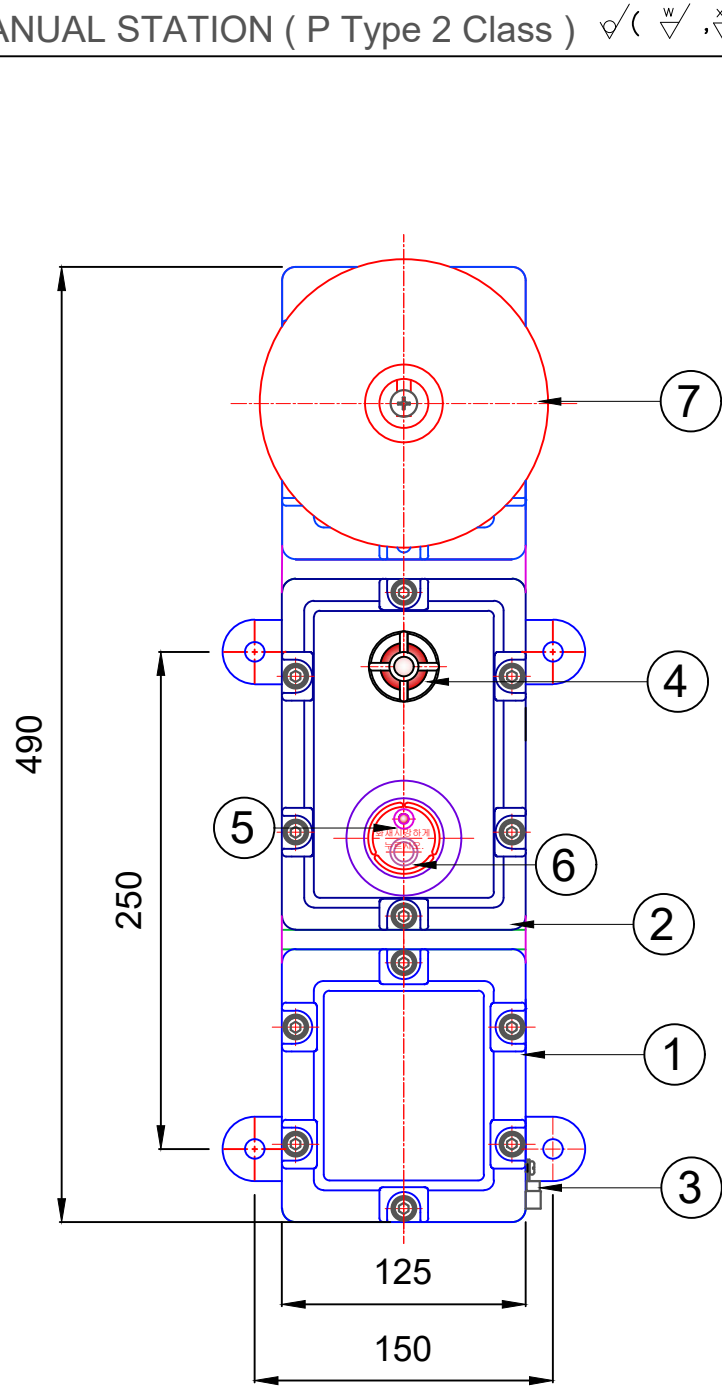


④ DC24V 30Ø INDICATING (RED)

⑥ FIRE

* TEMINAL NO

1	BELL
2	AMSWER
3	GRD
4	COM (-)
5	COM (-)
6	LAMP

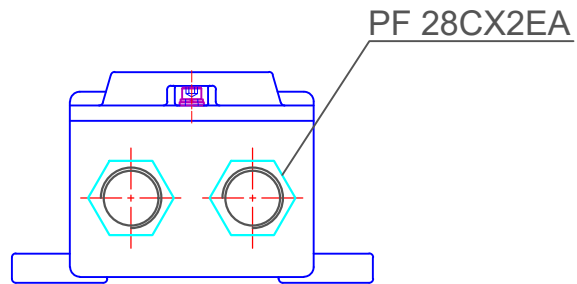

NO	PART NAME	MATERIAL	QTY	REMARK
1	Body	Cast Aluminium Alloy	1	
2	Main Cover	Cast Aluminium Alloy	1	
3	Terminal Lug	Copper	2	4sq
4	Pilot Lamp Ass'y	Brass	1 set	
5	LED Lamp Ass'y	Brass (Ni-plated)	1 set	
6	Push Button Ass'y	Brass	1 set	
7	BELL SIGNAL		1 set	

NOTES

HIMAX VIET NAM

NOTE

1. Rating : DC 24V
2. Tolerance specifications : KS B ISO2768-1
3. Non-Marking Chamfer & Round : R1.0, C1.0

THIET KE : HI-MAX VIET NAM

GIAM SAT : HI-MAX VIET NAM

FOR APPROVAL

REV	DATE	DESCRIPTION	DRWN	DSN	CHKD	APPD	APPD

Project Name
HI-MAX VIET NAM

HI-MAX VIET NAM CO., LTD

HI-MAX VIET NAM CO., LTD
Lo B5F, KCN Hiep Phuoc, Nha Be, Tp. HCM

Title
**EXPLOSION PROOF TYPE ALARM
MANUAL STATION (P Type 2 Class)**

Project No. Model Rev.

HI-MAX P - 2

Part Fire Alarm System Scale - Microfilm No.